

## NOTES:


- When used on high side of roadways, the cross slope of the gutter shall match the cross slope of the adjacent pavement. The height of the curb shall be 6", unless otherwise shown on plans.
- B Flush with gutter pan at curb ramp entrance or 3/4" vertical lip at driveway entrance.




CEMENT CONCRETE TRAFFIC CURB & GUTTER

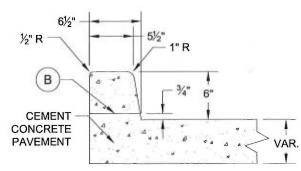


INTEGRAL CEMENT
CONCRETE TRAFFIC CURB

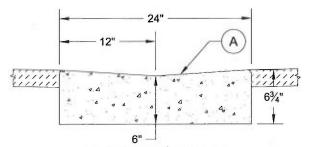

CEMENT CONCRETE VALLEY GUTTER

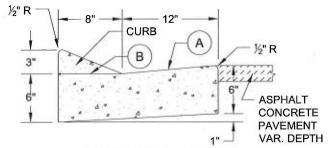


TYPE "C" MOUNTABLE
CEMENT CONCRETE CURB & GUTTER

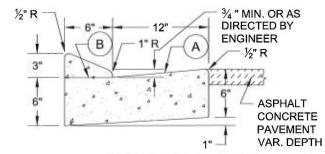

TYPE "D" MOUNTABLE CEMENT CONCRETE CURB & GUTTER

## NOTES:

- 1. For trench crossings, curb and gutter shall be removed to a minimum 2' cut back over undisturbed soil.
- 2. In all projects, any remaining sections of curb and gutter less than 5' in length between the project area and the nearest control joint shall also be removed and replaced.
- 3. All joints shall be saw cut full depth prior to restoration and  $\frac{3}{8}$ " expansion joint installed.
- Concrete finish shall match existing.
- 5. Cutting wheel run-out beyond the limits of the opening shall be filled in accordance with WSDOT Standard Specification 5-05.3(8)B for cement concrete surfaces and 5-04.3(5)C for asphalt concrete surfaces.
- 6. Foundations shall be fully compacted prior to form placement.
- 7. Unsuitable foundation shall be replaced with  $\frac{5}{8}$ " crushed surfacing top course.





APPROVED FOR PUBLICATION

8/16/16

CITY ENGINEER DATE

CITY OF TACOMA

CEMENT CONCRETE CURB AND GUTTER

STANDARD PLAN NO.

SU-03