


AMENDED SOIL PER BMP L613 OPTION 2, 3, OR 4, OR SUBGRADE MATERIAL AS REQUIRED WHERE COVERED BY HARD SURFACE. SEE NOTE 7.

PLAN VIEW OF ROOF
NTS

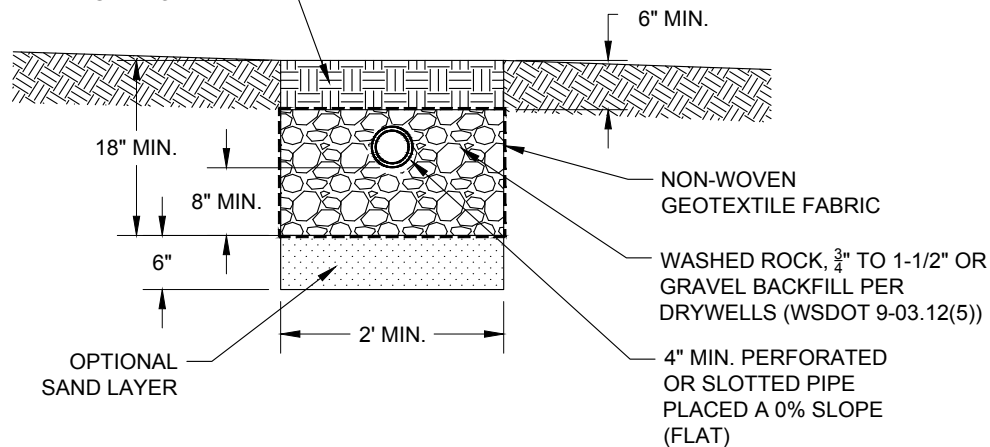

PERFORATED STUB-OUT SECTION
NTS

NOTES:

1. Provide 10 feet of perforated pipe per 5,000 square feet of roof area laid in a level, 2-foot wide trench.
2. 3/4" - 1 1/2" washed rock or WSDOT Specification 9-03.12(5).
3. Place non-woven geotextile fabric along walls, bottom, and top of washed rock. Non-woven geotextile to conform to WSDOT Spec. 9-33.2(1), Tables 1 and 2.
4. A minimum one foot of separation is required from the trench bottom to the seasonal high ground water.
5. Perforated stub-out to be sized and located per SWMM BMP L604.
6. Do not build on slopes steeper than 20%.
7. All disturbed areas not covered with hard surfaces shall be stabilized by planting and mulching.
8. Cleanouts recommended at pipe bends and one end of the perforated section.



**CITY OF TACOMA
GREEN STORMWATER INFRASTRUCTURE
TYPICAL DETAILS**

PERFORATED STUB-OUT CONNECTION

FIGURE NO.

007

January 2016