


WALLED BIORETENTION OFFSET FROM BUILDING
NTS

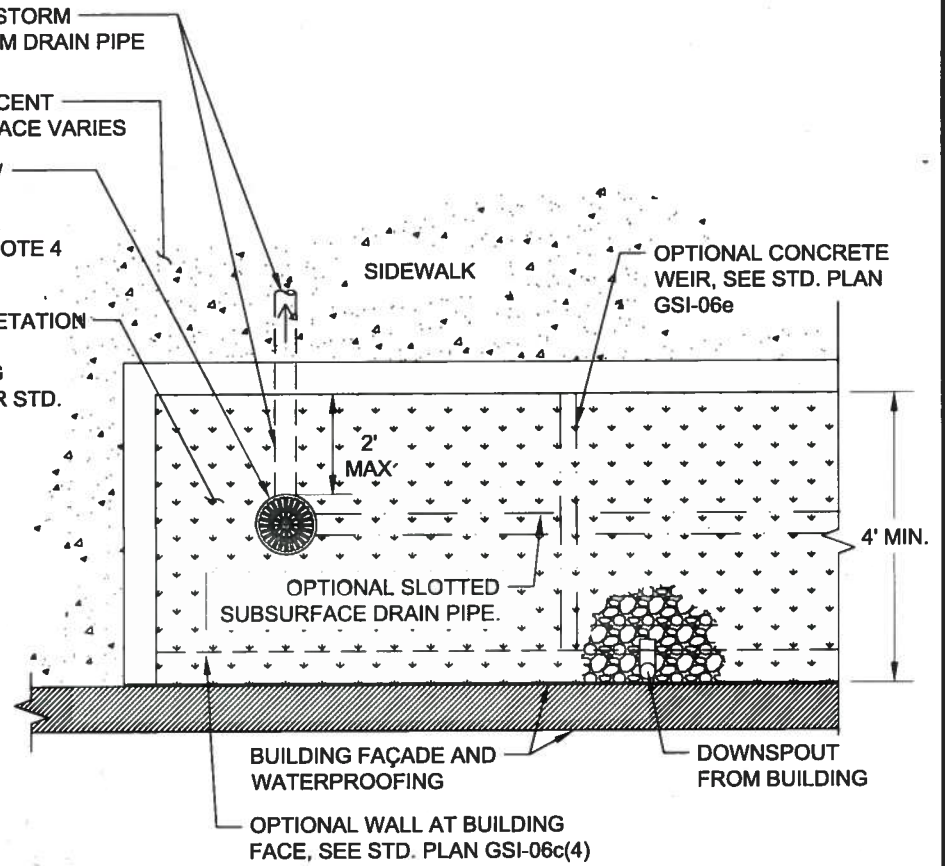

WALLED BIORETENTION ADJACENT TO BUILDING
NTS

NOTES:

1. Existing and proposed utility lines to be located outside of facility footprint unless otherwise approved by City of Tacoma.
2. Abandoned utilities within footprint of facility and observed during construction shall be removed. Coordinate with utility provider and City of Tacoma.
3. Penetrations through facility wall shall be watertight and shall prevent preferential flow into utility trenches (e.g. water stop, trench block, or trench collar), as appropriate.
4. Alternate overflow may be allowed. Pipe from overflow structure not shown for clarity. See Std. Plans GSI-13 and GSI-14.
5. See Std. Plans GSI-06c(2) and GSI-6c(4) for section view.
6. Skateboard stops or wall notch stops may be required based on location and size. Wall notch stops shall be 3" wide and 2" deep.

DCS

REVIEWED BY

GMS

PUBLIC WORKS

ENVIRONMENTAL SERVICES

NA

NA

TACOMA POWER

TACOMA WATER



APPROVED FOR PUBLICATION

[Signature]
CITY ENGINEER

[Signature] 4/4/15
DATE

CITY OF TACOMA
WALLED BIORETENTION
FOR BUILDING DOWNSPOUTS
PLAN VIEW
STANDARD PLAN NO. GSI-06c(1)