

MODIFIED CONC CURB & GUTTER PER STD. PLAN SU-03

GRADE BREAK FOR DEPRESSION (TYP.)


MATCH EXISTING

COBBLES PER NOTE 2


CONCRETE CURB & GUTTER PER STD. PLAN SU-03 (TYP)

NOTES:

1. For curb cuts into bioretention see SWMM BMP L630.
2. Cobbles shall be 6" cobbles per WSDOT 9-03.11(2). Cobble pad to be 8" thick by the width of the concrete pad plus 6 inches on either side (width 24" min. to 30" max.) for 12" from opening then taper to 12" wide.

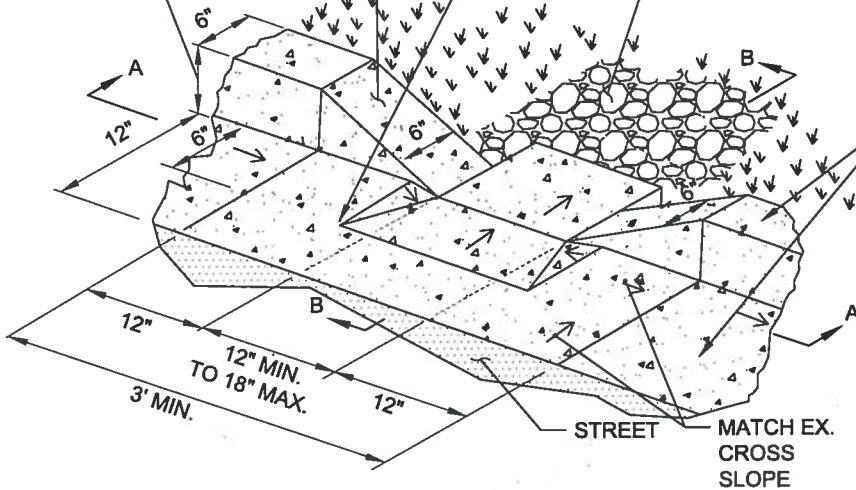

INLET CURB CUT OPENING
NTS

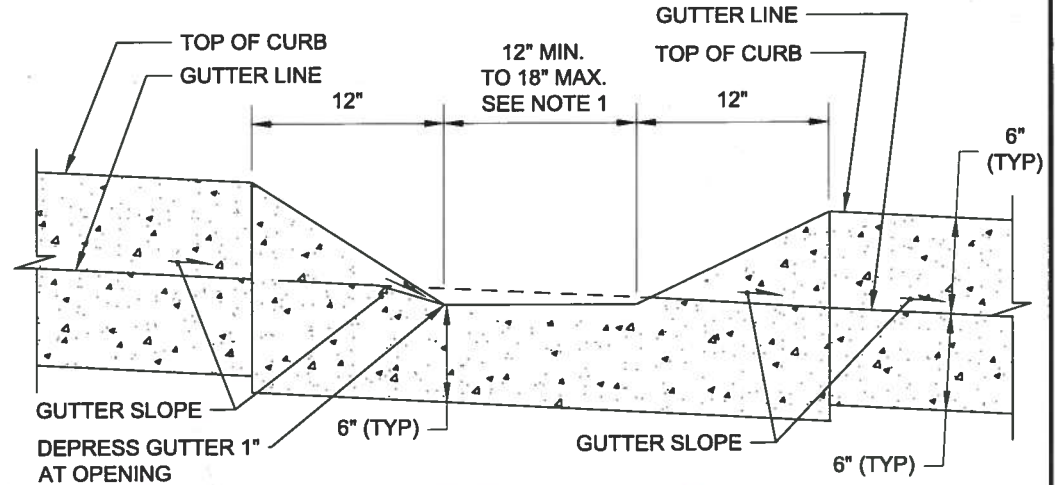

SECTION A-A
NTS

TYPICAL GUTTER ELEVATION FLOW LINE REFERENCE LOCATION

SEE STD. PLAN GSI-04

TOP OF BANK ELEVATION

STREET

BOTTOM

2'

COBBLES, SEE NOTE 2

4" CSTC

MODIFIED CONC CURB & GUTTER

DEPRESS GUTTER 1"

PROVIDE 2" MIN. TOTAL ELEVATION DIFFERENCE FROM TYPICAL GUTTER ELEVATION TO TOP OF ROCK AT END OF CONCRETE PAD

COMPACT BIORETENTION SOIL MIX UNDER COBBLES TO 90% MAX. MODIFIED PROCTOR DENSITY (ASTM D1557)

SECTION B-B
NTS

REVIEWED BY


DCS

PUBLIC WORKS

ENVIRONMENTAL SERVICES

NA

TACOMA WATER



APPROVED FOR PUBLICATION

[Signature]
CITY ENGINEER

DATE

CITY OF TACOMA
CURB CUT FOR FACILITY
WITH GRADED SIDE SLOPES

STANDARD PLAN NO.

GSI-09a