
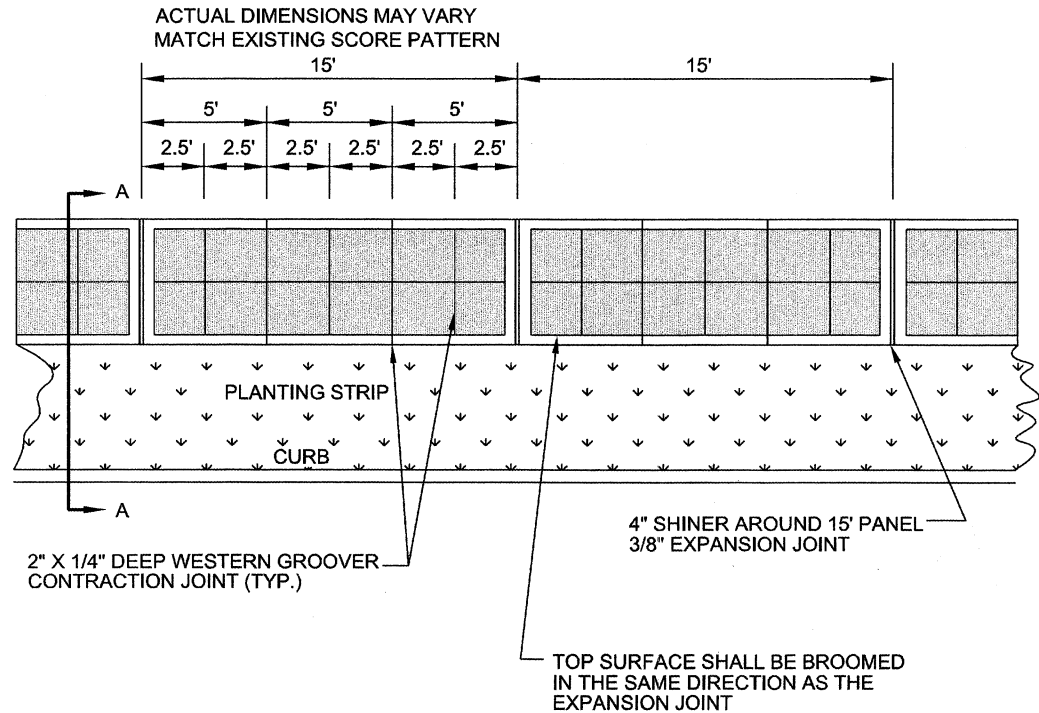


NOTES:

1. Sidewalks shall be designed and constructed in accordance with ADA Standards for Accessible Design, 28 CFR, Part 35 and as supplemented by the Public Right of Way Accessibility Guidelines (PROWAG).
2. Staking is required where no curb is present.
3. All expansion joints shall be full depth with 3/8" premolded joint filler.
4. All joints shall be cleaned and edged. External edges shall be 1/2" radius. Internal joints shall be 1/4" radius.
5. All soft and yielding foundation material shall be removed and replaced with crushed surfacing top course (CSTC) meeting the requirement of Section 9-03.9(3) of the WSDOT Standard Specifications.
6. All sidewalk shall be replaced to the nearest expansion or contraction joint. All joints shall be saw cut full depth prior to restoration and 3/8" expansion joint installed. Cutting wheel run-out beyond the limits of the opening shall be filled in accordance with WSDOT Standard Specification 5-05.3(8)B for cement concrete surfaces and 5-04.3(5)C for asphalt concrete surfaces.
7. Apply lamp black 1lb. per cubic yard of cement concrete or as required for desired discoloration in accordance with ASTM D209-81 standard specification for lamp black pigment.

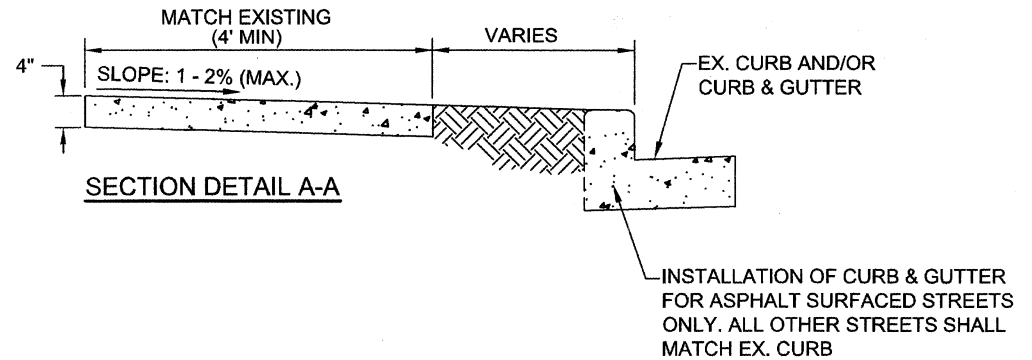

<p>CITY OF TACOMA DEPARTMENT OF PUBLIC WORKS</p>	<p>APPROVED FOR PUBLICATION</p> <p><i>[Signature]</i> CITY ENGINEER</p> <p>12/6/15 DATE</p>	<p>NORTH SLOPE HISTORIC DISTRICT CEMENT CONCRETE SIDEWALK</p> <p>STANDARD PLAN NO. HD-NS03</p>
--	---	--