
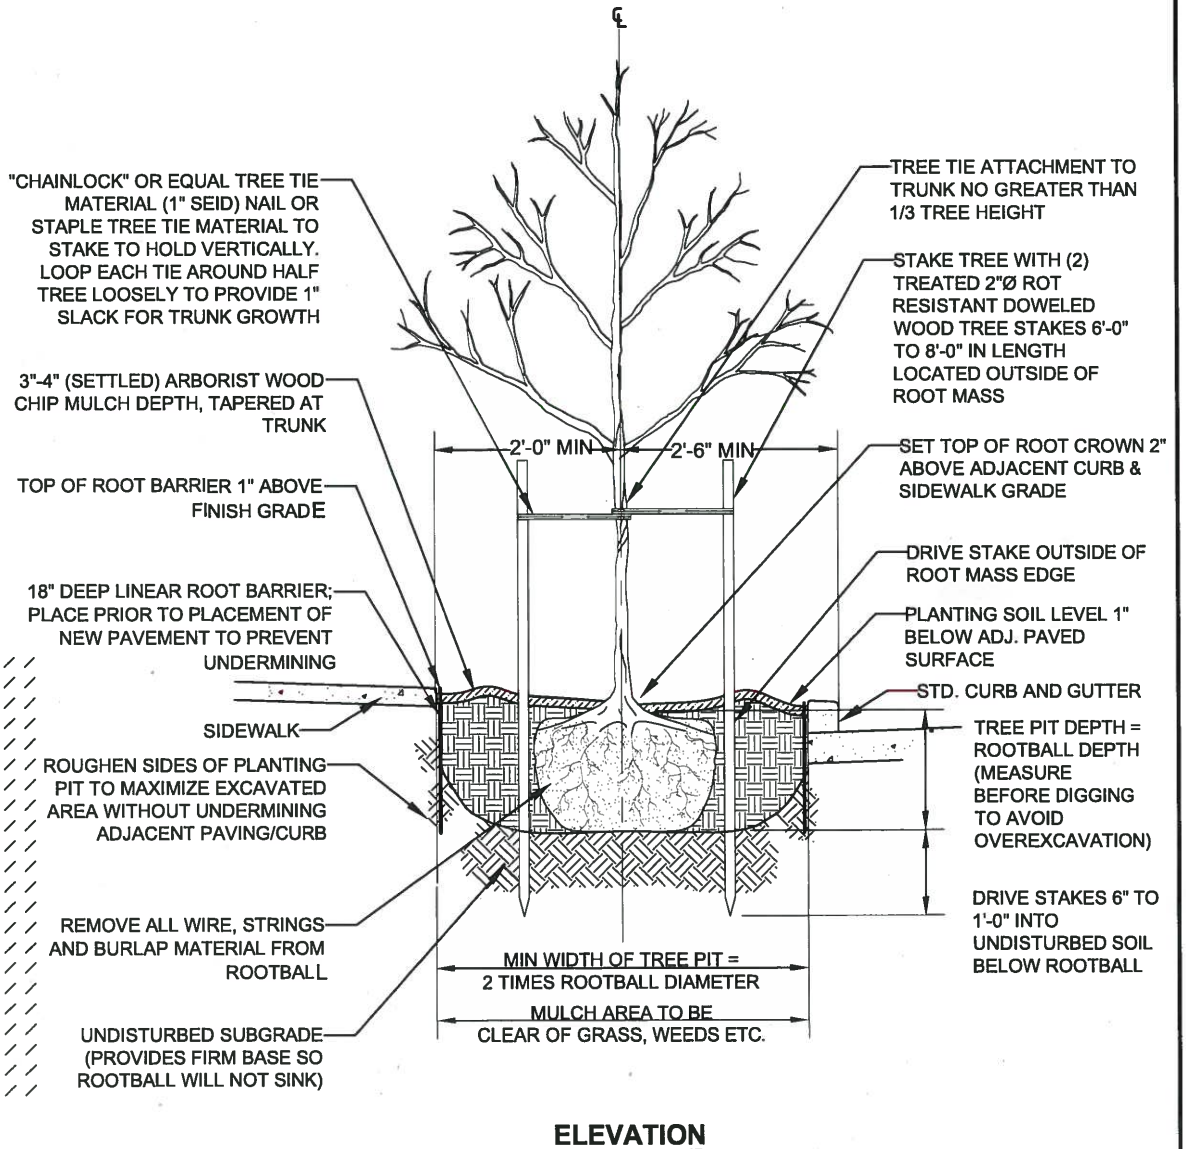


**NOTES:**

1. Planting includes removal of stakes one year after installation.
2. Shape soil surface to provide 4' dia watering ring.
3. Tree clearance shall be per STD PLAN LS-02.
4. See STD PLAN LS-03 for tree well dimension detail.
5. Root barriers shall be an injection molded or extruded modular component made of high density polypropylene or polyethylene plastic. 18" depth x 10' length root barrier is required along edge of roadways, curbs, driveways, trails, sidewalks, or other structures where root ball is within 4 feet. install root barrier for newly planted trees only.

MULCH TREE PIT MIN 5'-0" LENGTH AND FULL PLANTING STRIP WIDTH BETWEEN CURB AND SIDEWALK, FOR PLANTING STRIPS LESS THAN 6'-0" WIDE; OR PROVIDE 5'-0" DIA MULCH RING, FOR PLANTING STRIPS WIDER THAN 6'-0".

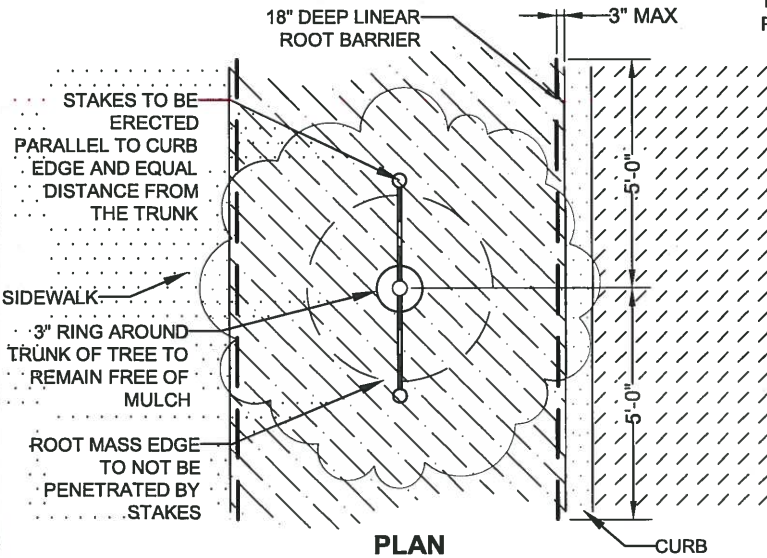

**CITY OF TACOMA  
DEPARTMENT OF PUBLIC WORKS**

**APPROVED FOR PUBLICATION**

*[Signature]*  
CITY ENGINEER

*2/2/15*  
DATE

**STREET TREE PLANTING**

STANDARD PLAN NO. **LS-01**