
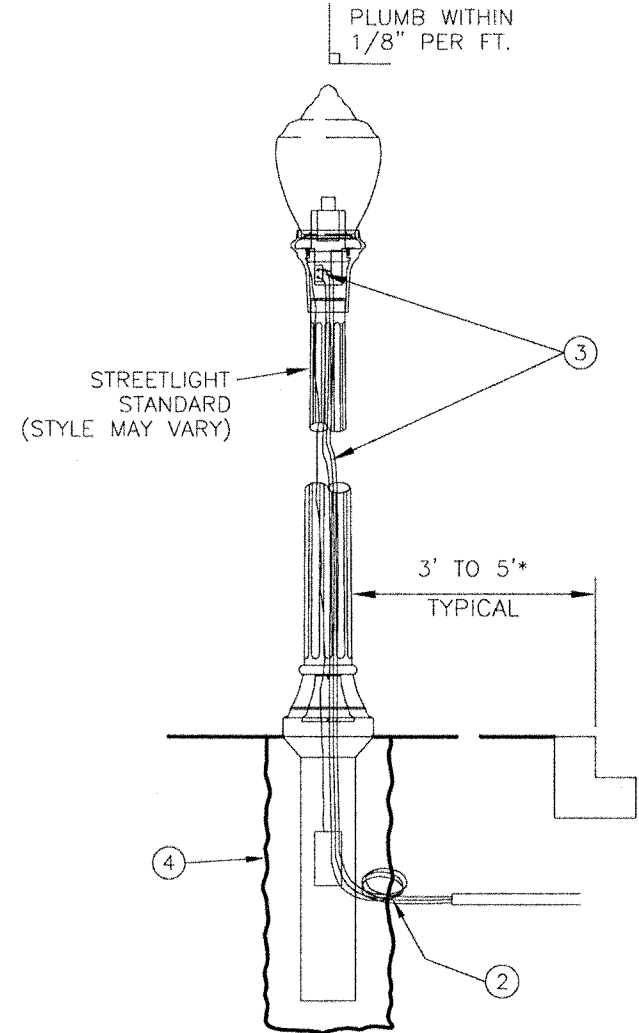


NOTES:

- ① INTERCEPT EXISTING CONDUIT, WHERE APPLICABLE, AND ROUTE TOWARD LIGHT STANDARD. TERMINATE CONDUIT(S) APPROXIMATELY 12" FROM BASE OF STANDARD. SEAL END OF CONDUITS WITH TAPE.
- ② COIL THREE FEET OF WIRE AT END OF CONDUIT BEFORE ENTERING BASE OF STANDARD.
- ③ ROUTE WIRE UP TO TERMINAL BLOCK WITHOUT SPLICING.
- ④ MINIMUM AUGER SIZE IS 12". BACKFILL WITH CRUSHED SURFACING TOP COURSE. TAMP IN 6 INCH LIFTS.
- ⑤ SQUARE POLE TO CURB ± 3 DEGREES.

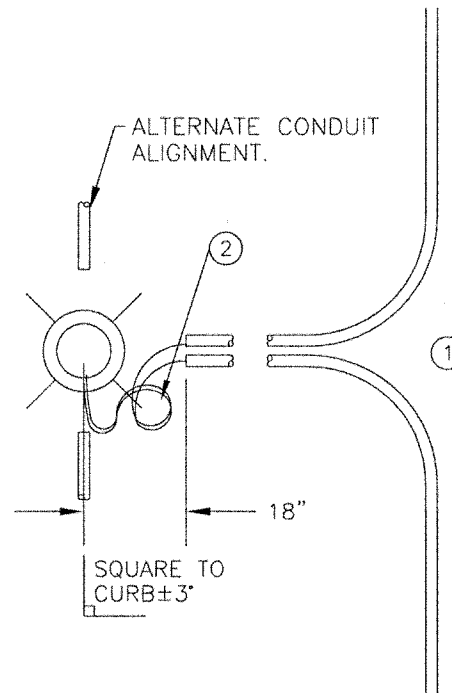

* OR AS DETERMINED BY ENGINEER

CITY OF TACOMA
DEPARTMENT OF PUBLIC WORKS

APPROVED FOR PUBLICATION

CITY ENGINEER

3/10/03

DATE 2/4/03

STREETLIGHT
STANDARD EMBEDDED TYPE
INSTALLATION DETAIL-TYPICAL

STANDARD PLAN NO. SL-03