


NOTES:

1. Location on mains per plan sheet.
2. Review design with the City for utilities greater than 36 inches in diameter.
3. For service lines, install trench dams at approximate back of walk where utility services are installed beyond the permeable ballast section.
4. Ductile iron pipe shall be encased in a polyethylene sleeve, meeting the requirements of American Waterworks Association (AWWA).



<u>DCS</u>	REVIEWED BY	<u>BMS</u>
PUBLIC WORKS	ENVIRONMENTAL SERVICES	
<u>NA</u>		<u>NA</u>
TACOMA POWER	TACOMA WATER	

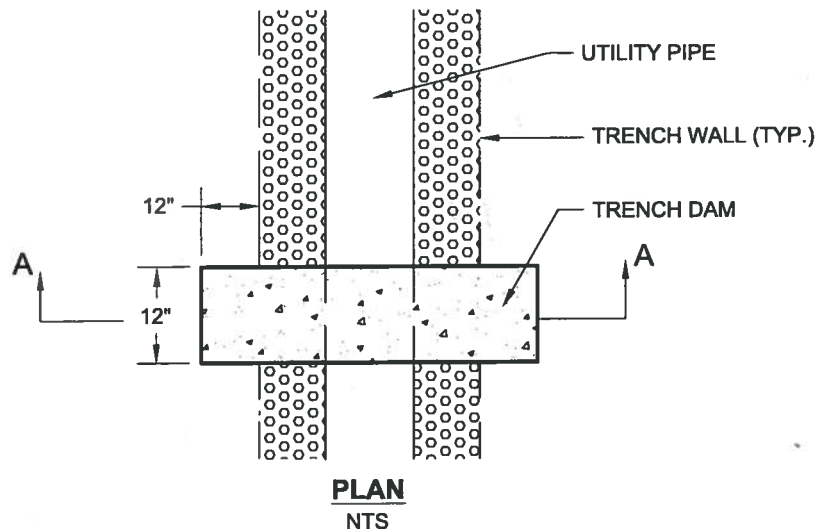

APPROVED FOR PUBLICATION

[Signature]

CITY ENGINEER

4/2/16

DATE

CITY OF TACOMA

TRENCH DAM

STANDARD PLAN NO. SU-33