


36" DIA CEMENT CONCRETE COLLAR, 6" THICK.
(REQUIRED IN ASPHALT PAVING ONLY)

GROUND/PAVEMENT LINE

1 1/2" MIN

VALVE CHAMBER

VALVE

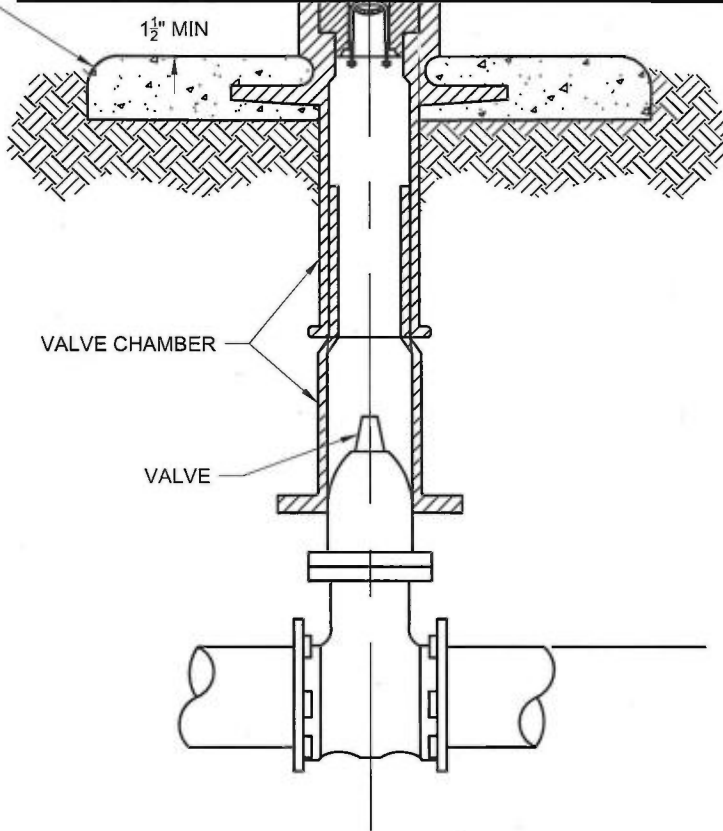

NOTES:

Class 3000 cement concrete shall be placed, 1 1/2" min, below the finished pavement surface.

24-hours after placing the cement collar, HMA Class 3/8" PG 64-22 shall be placed in accordance with Standard Plan SU-15.

If the valve chamber being adjusted belongs to Tacoma Water, the Contractor shall contact Tacoma Water, Operations, at 253-502-8742 for final inspection.

REVIEWED BY

DCS
PUBLIC WORKS

GMS
ENVIRONMENTAL SERVICES

N/A
TACOMA POWER

G.W.
TACOMA WATER



APPROVED FOR PUBLICATION

[Signature]
CITY ENGINEER

5/31/19
DATE

CITY OF TACOMA
VALVE CHAMBER
COLLAR DETAIL

STANDARD PLAN NO. SU-37